



ISO8528

GC ;) &

SZUTEST

GC - \$\$\$

CE

2000/14/EC

&\$\$\$#(#

z*\$' z'z' D:

	"	kw	"	kw	Amp
480/277		410,00		358,00	538,00
380/220		407,00		356,00	676,00
208/120		408,00		356,00	1235,00

fPQDE

GC ;) &

) & z

fDF DE

%\$1

%

%&

GC " \$(**

z&(

GC

Standard Specifications

z

fl

!

E

z

z

ALTERNATOR

D; A z'5JF


TRANSFER SWITCH

Manufacturer		Doosan		
Model		P 158 LE		
		% \$ \$	"# "	
		458,00 kw [614,00HP]		
	L	14,600		
	"	128x142		
		15:1		
	fl # ı	"# "	1800	
	L	21,00		
	L	68,50		
AbsorbedAirDischargeReSourceKey.Text	' # "	36,90		
	' # "	91,30		
	° C	606,00		
		24 V d.c.		
	Load	% \$ \$ı	'+)ı) \$ı
	# "	102,50	74,70	50,60

		Stamford		
		HCI544C		
	Hz	60		
	kw	475,00		
7 cg		0,80		
		3		
	fl ı	480/277		
	A	714,00		
Temperature		H		

		fl ı		fl ı	
	"	"	"	"	L
AD 408-6	3275,00	3106,00	1550,00	1994,00	700,00
		fl ı		fl ı	
	"	"	"	"	L
MS 70	4295	4460	1606	2477	700

1 D+ &

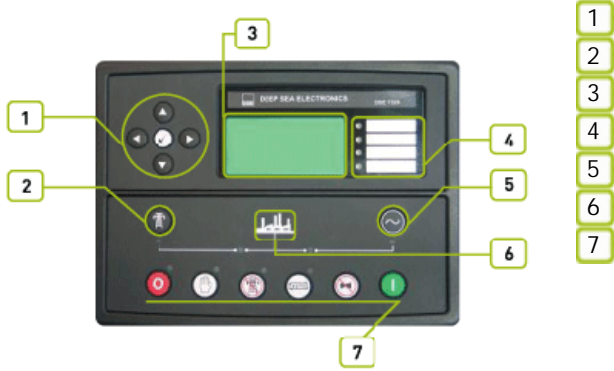

2

8G9ž + &\$ž) 5ž&&\$#(\$

3

4

5

8G9+' &\$
&&\$ ž

8G9+' &\$

8G9+' &\$

% &1 *(

žFG& žžFG(,) ž

f@z@Bl
f@z@Bl

"z" "z" "z"

f@z@Bl

971

#

#

#

#

#

6G'9B**\$-\$)

6G'9B**%\$\$\$!*!&

6G'9B**%\$\$\$!*!(

f&%) +L

f&)(, L

f&% \$L

GA 8

!&+""


%, !&*(

&(\$)

ž

ž

ž

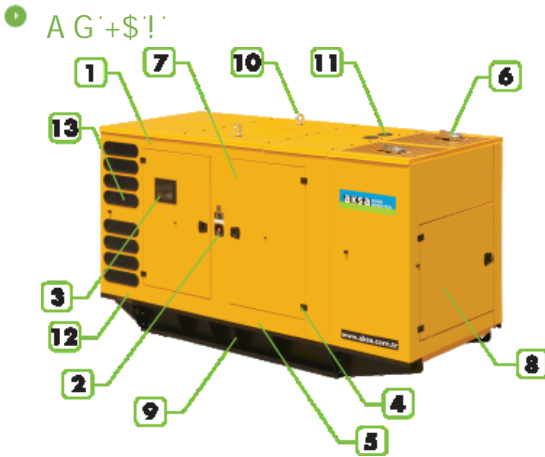

- 1 Steel structures.
- 2 Emergency stop push button.
- 3 Control panel is mounted on the baseframe . Located at the right side of the generator set.
- 4 Corrosion-resistant locks and hinges.
- 5 oil could be drained via valve and a hose
- 6 Exhaust system in the canopy.
- 7 special large access doors for easy maintenance
- 8 in front and back side special large access doors for easy maintenance
- 9 Base frame -fuel tank.
- 10 Lifting points similar to ISO container , located on each top corner of the canopy
- 11 the canopy provides easy access to radiator cap.
- 12 sound proofing materials
- 13 Plastic air intake pockets.

	"	1606
fl "L	"	4460
fl "L	"	2477
	L	700